


AQUAMARINESM swimming pool heat exchangers

WARNING

Chlorinators must feed downstream of the heat exchanger and have an anti-siphoning device to prevent chemical back-up in the heat exchanger when the pump is shut off. Stabilize chemistry to pH of 7.2-7.8 with chlorine residual at 1 to 3 ppm. Damage to the heat exchanger due to improper water chemistry is not covered under warranty.

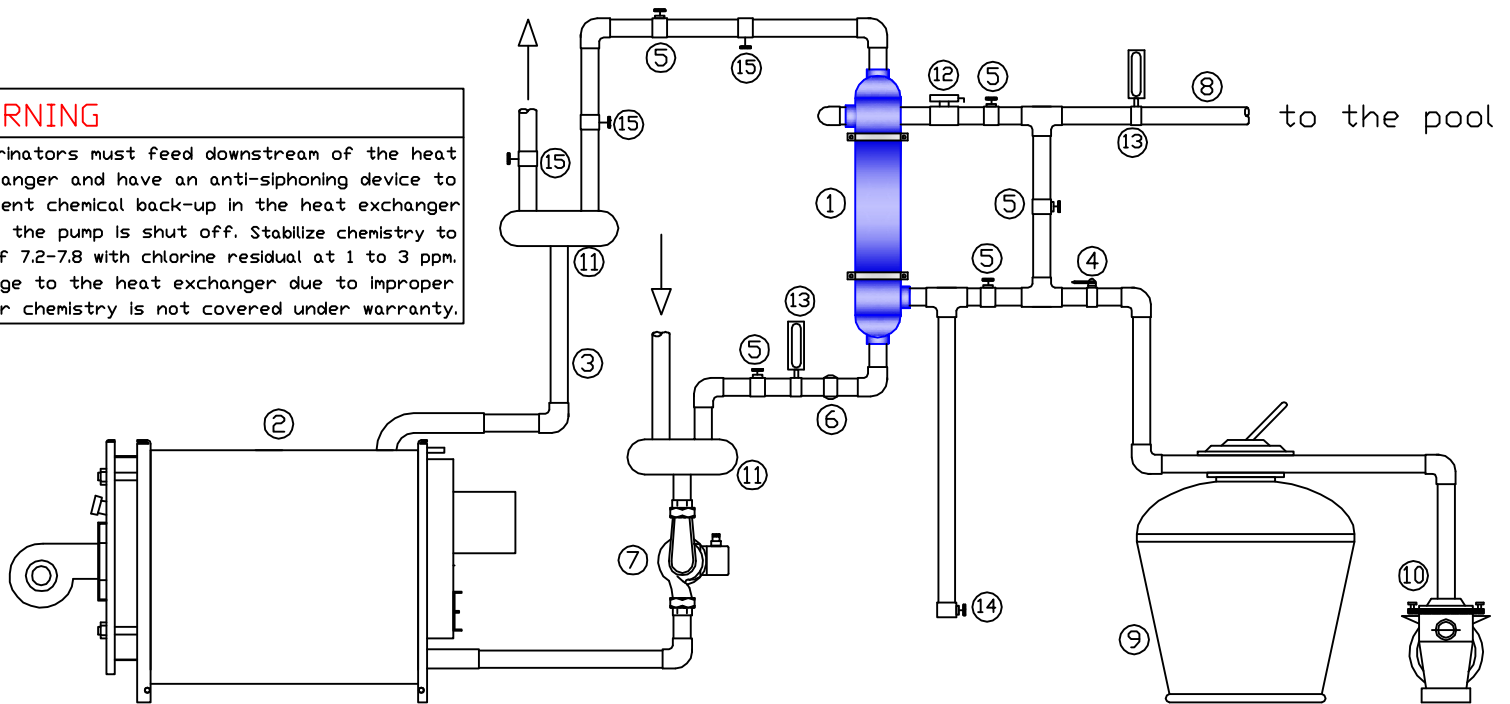

LEGEND

1. Aquamarine [®] Heat Exchanger	6. check valve	11. collector
2. boiler	7. circulator	12. flow switch
3. boiler water circuit	8. pool water supply	13. thermometer
4. thermostat	9. filtration	14. drain valve
5. Gate valve	10. pump	15. flow control valve